

ANTUMBRA
ETHERNET KEYPAD
+ COMMUNICATION
MODULE

100-277 VAC
(NOT BY SIGNIFY)

DATA
ENABLER
PRO


POE SWITCH

CAT 5e/6
(NOT BY SIGNIFY)


CAT 5e/6
(NOT BY SIGNIFY)

OUT TO
ADDITIONAL DEP
IN DAISY CHAIN


REACHELITE 300W

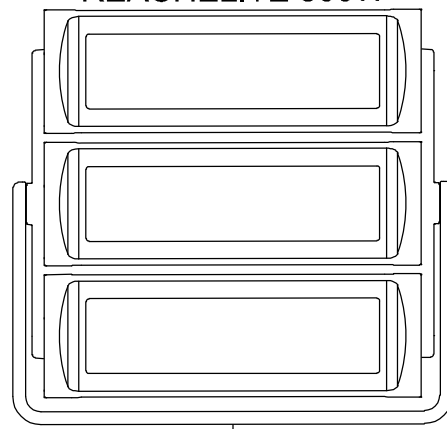

REACHELITE 300W

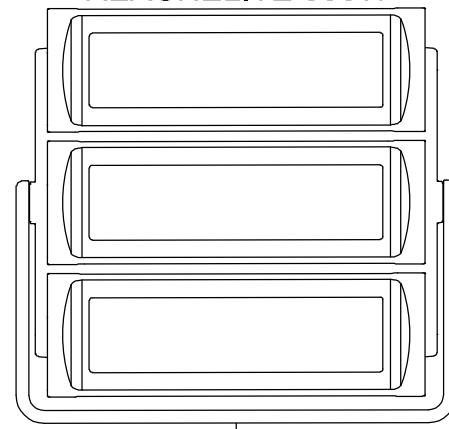

REACHELITE 300W

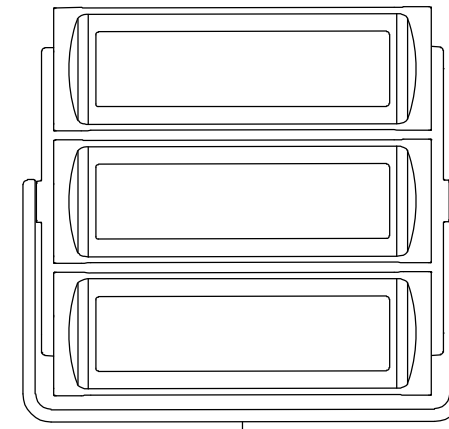

REACHELITE
LEADER CABLE

REACHELITE
LEADER CABLE

REACHELITE
LEADER CABLE

ON TO
ADDITIONAL
FIXTURES

JUNCTION BOX
(NOT BY SIGNIFY)



JUNCTION BOX
(NOT BY SIGNIFY)

JUNCTION BOX
(NOT BY SIGNIFY)

3 CONDUCTOR
+ GROUND
(NOT BY SIGNIFY)

NOTES:

- A. REFER TO INSTALLATION INSTRUCTIONS AND PRODUCT GUIDES AT WWW.COLORKINETICS.COM FOR ALL COLOR KINETICS PRODUCTS INCLUDED IN THIS DIAGRAM.
- B. CONSULT PRODUCT GUIDE OR THE CONFIGURATION CALCULATOR FOR MAXIMUM FIXTURE QUANTITIES FOR THIS SYSTEM.
- C. TOTAL CABLE LENGTH OUT OF A TYPICAL DATA ENABLER PRO CANNOT EXCEED 400' MAX. ANY SINGLE RUN OF CABLE FROM THE LAST/FURTHEST FIXTURE IN A RUN BACK TO THE DATA ENABLER PRO CANNOT EXCEED 175'.
- D. SURGE PROTECTION SHOULD BE CONSIDERED FOR ALL COLOR KINETICS SYSTEMS.
- E. ALL CONTROL EQUIPMENT SHOULD BE LOCATED INDOORS OR OUTDOOR RATED ENCLOSURE (BY OTHERS). REFER TO PRODUCT DATA SHEETS FOR ENVIRONMENTAL PROTECTIONS/IP RATINGS.
- F. THIS IS A RECOMMENDED SYSTEM CONFIGURATION AND THE ACTUAL INSTALLATION MAY VARY IN FIELD. THIS TYPICAL RISER DIAGRAM SHALL NOT BE USED FOR CONSTRUCTION.

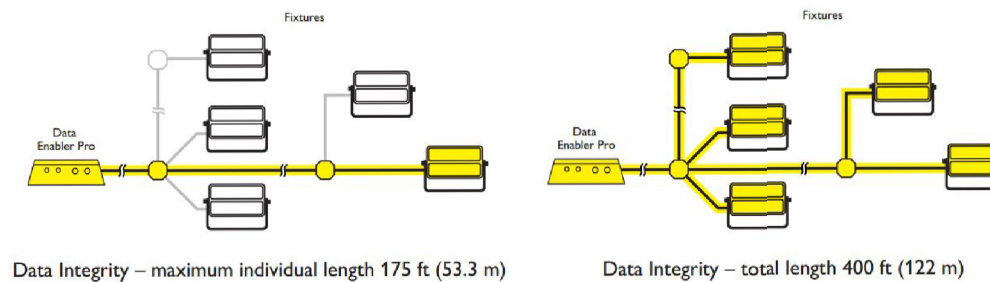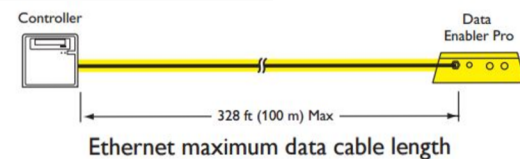

NOT FOR CONSTRUCTION

REV	REVISION DESCRIPTION	BY	DATE

CK STANDARD WIRING DIAGRAMS

REACHELITE300
DATA ENABLER PRO
ANTUMBRA ICOLOR KEYPAD

-

REA2-DEP-KEY-NO



Tel: 800.555.0050
1 Van de Graaff Drive
Burlington, MA 01803

THIS DRAWING IS THE PROPERTY OF SIGNIFY AND CONTAINS PROPRIETARY INFORMATION. THIS DRAWING SHALL NOT BE REPRODUCED, COPIED, OR USED WITHOUT PRIOR EXPRESSED WRITTEN PERMISSION. (C) 2023 SIGNIFY HOLDING - All Rights Reserved.
Specifications are subject to change without notice. No representation or warranty as to the accuracy or completeness of the information included herein is given and any liability for any action in reliance thereon is disclaimed. Philips and the Philips Shield Emblem are registered trademarks of Koninklijke Philips N.V. All other trademarks are owned by Signify Holding or their respective owners.

STATUS	SCALE
DRAWN AM	1'-0" = 1'-0"
CHKD	DATE 3/13/2024
PM	SECTION
ECD	